

THE PORT AUTHORITY
OF NY & NJ



ORIGINAL SIGNED & SEALED BY
N.Y. P.E. (OR R.A.)

**Joseph R. Loring
& Associates, Inc.**
consulting engineers
One Pennsylvania Plaza
New York, New York 10004-0045
Tel: (212) 512-7400, Fax: (212) 512-7382

THE OFFICE OF
D.W.D.
ELLIOT
LEBOVITZ
P.C.
ARCHITECTS & PLANNERS
10 WEST 40TH STREET, NEW YORK, NY 10018
TELEPHONE: (212) 267-0000 FAX: (212) 267-0001

**LESLIE E. ROBERTSON
ASSOCIATES, R.L.L.P.**
CONSULTING ELECTRICAL ENGINEERS
200 EAST 42ND STREET, NEW YORK, NY 10017
TELEPHONE: (212) 697-0000 FAX: (212) 697-0001

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT
COPY OF ONE OF THE CONTRACT DRAWINGS FOR
SITING A PART OF CONTRACT NO. WTC-946.071
IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT
THE TIME THE SAID CONTRACT WAS EXECUTED BY
THE PARTIES.
DATE 11/16/97 *Stanley A. Adelman* SEC. WRITER
DATE 11/10/97 *P.L. Lawrence* ENGINEER OF DESIGN

12/31/97 ADD. PT. PLAN
12/22/97 MODIFY REFERENCES
11/17/97 ISSUED FOR BID

No. Date Revision Approved
Engineering Department
Design Divisions

**The
World
Trade
Center**

Title
**STANDBY POWER
5 WORLD TRADE CENTER**

ELECTRICAL


**RIVER WATER
PUMP
MODIFICATIONS**

This drawing subject to conditions in contract.
All inventions, ideas, designs and methods
herein are reserved to Port Authority and
may not be used without its written consent.


F.P.P. D.M.
Designed by Drawn by Check by

Date 11/17/97 Scale AS SHOWN


Contract Number Drawing Number
WTC-946.071 ET-07

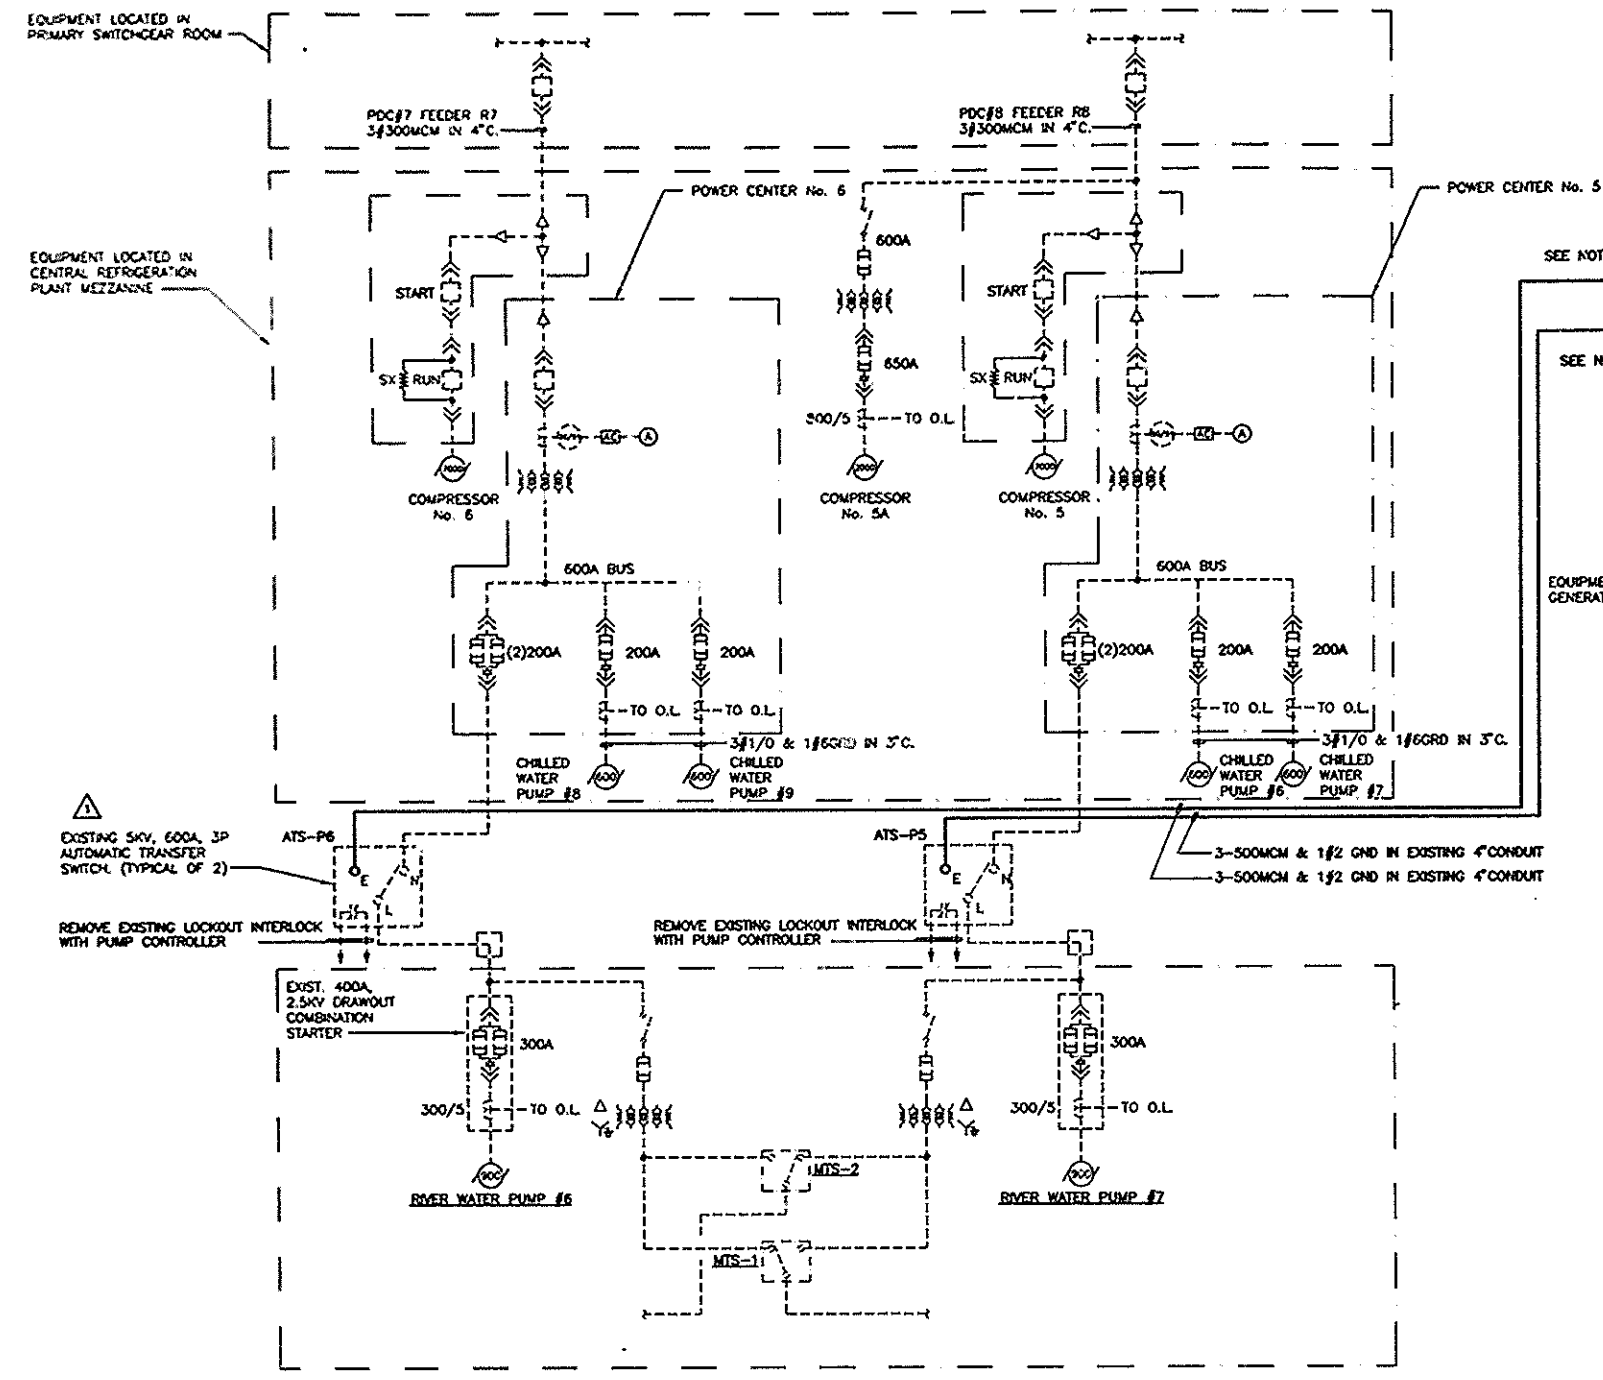

**ONE LINE DIAGRAM
WATER RIVER PUMP MODIFICATIONS**
NOT TO SCALE

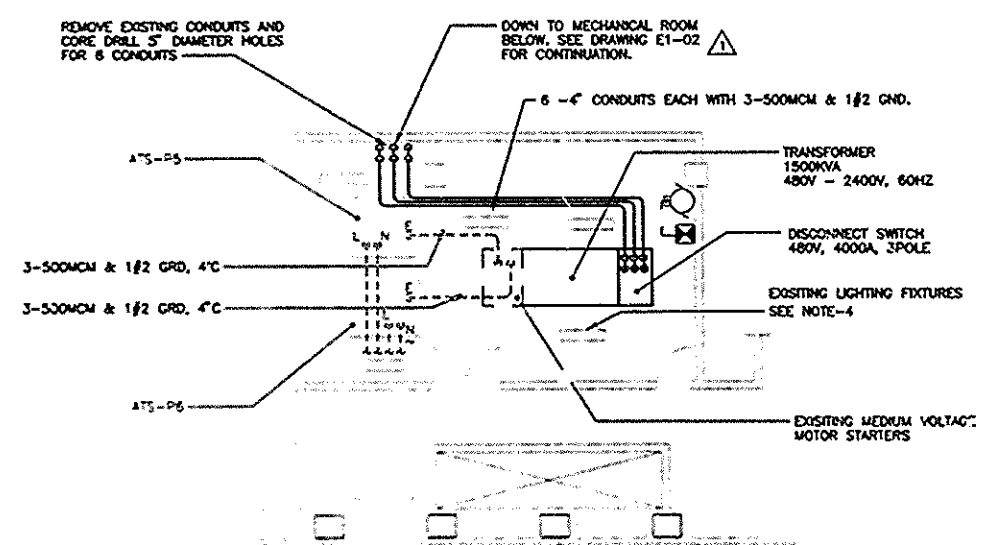

**PLAN - POWER CENTER 'EPC' ROOM
ELEV. 264 LEVEL 1 WTC**

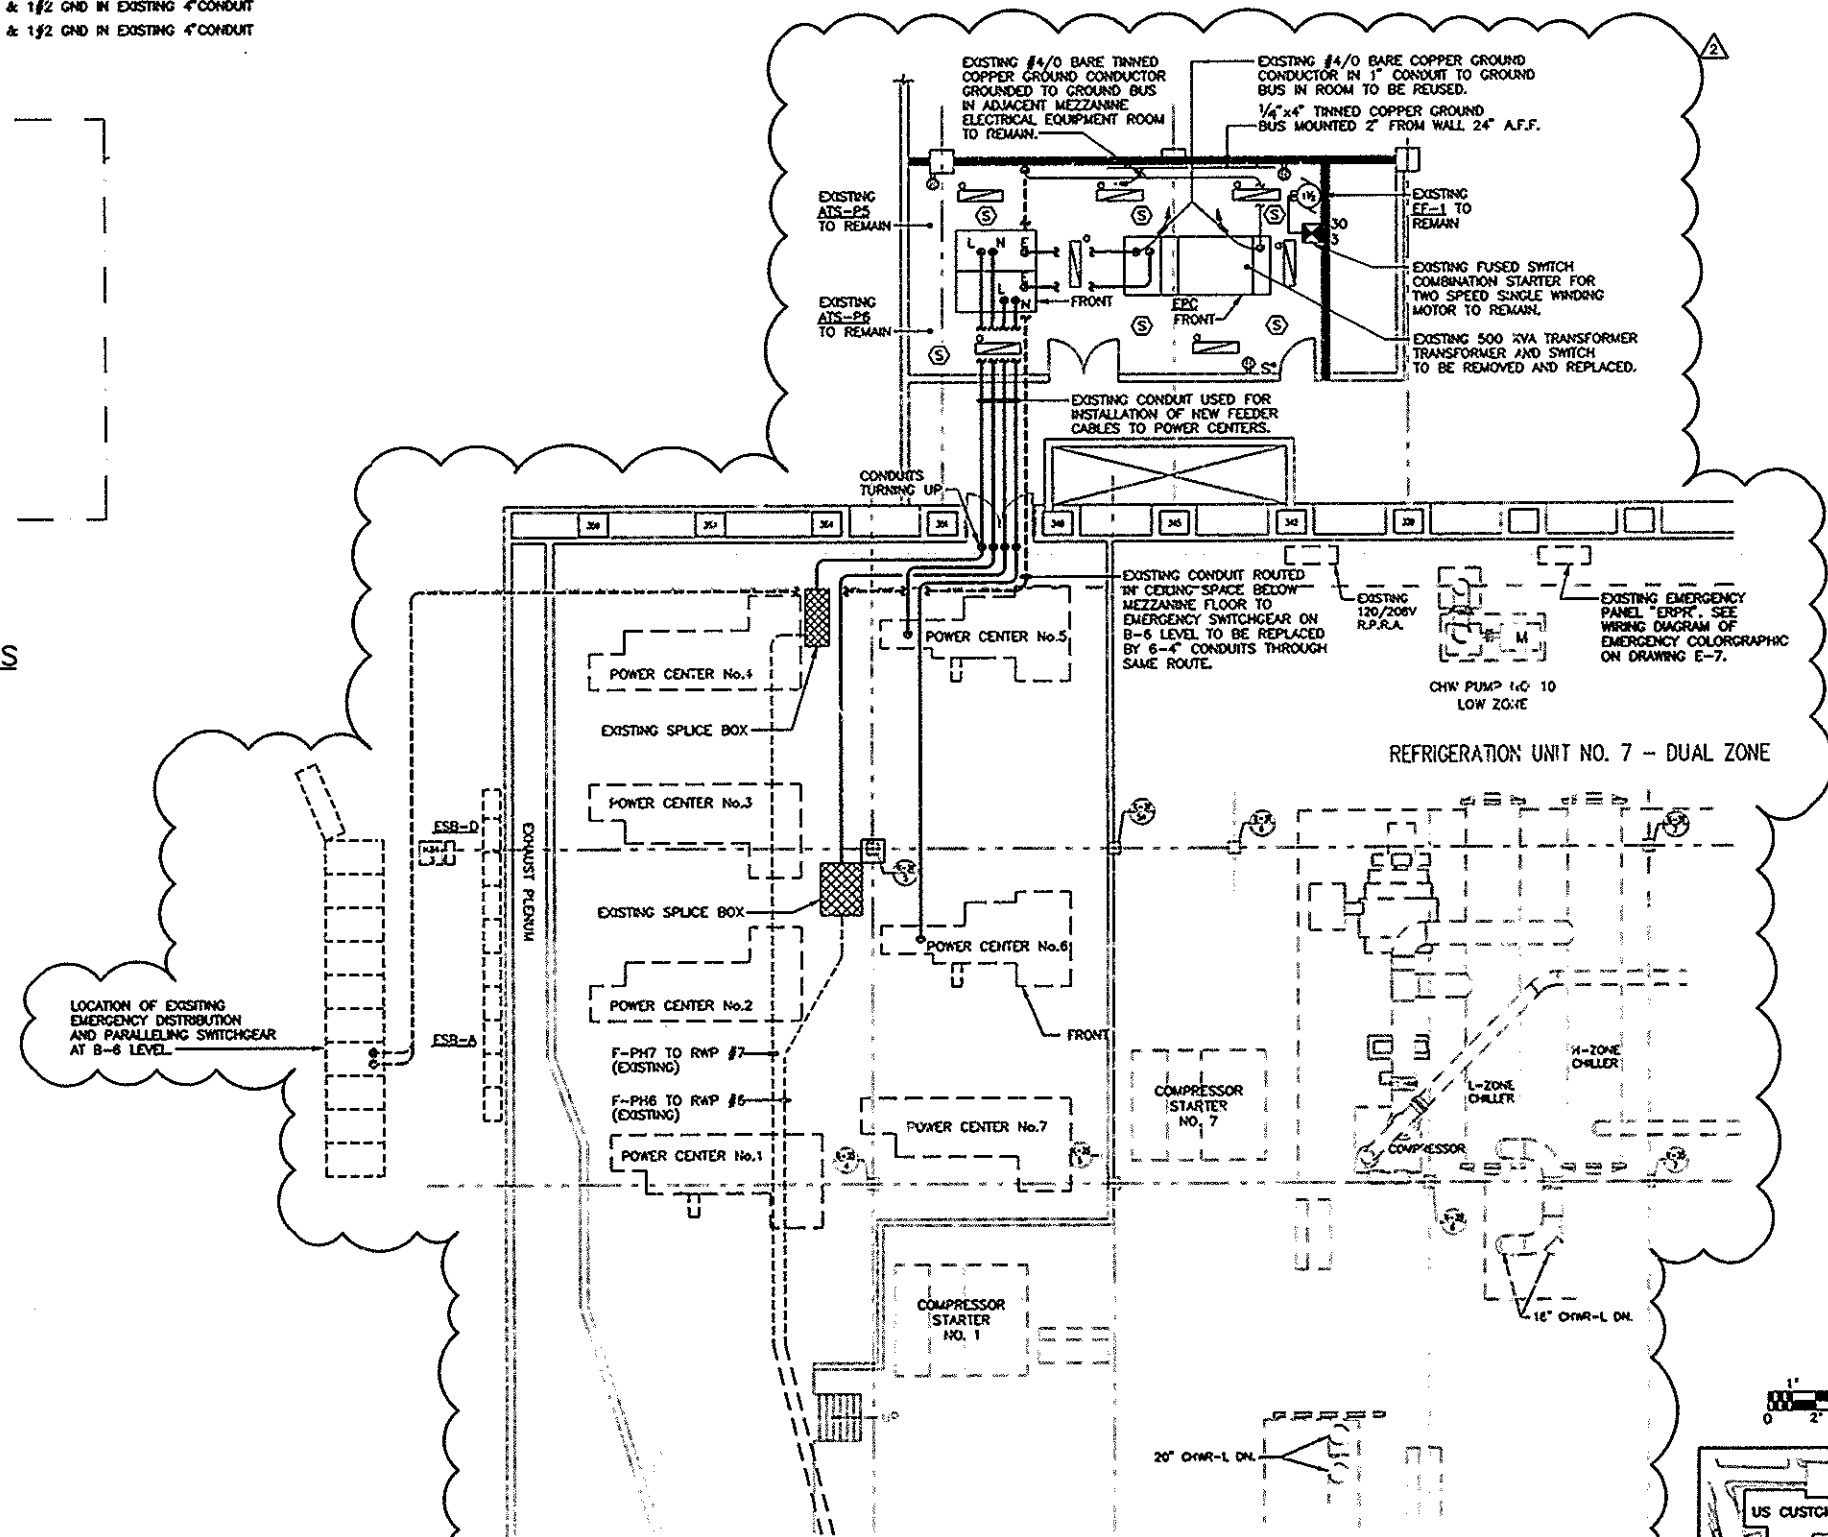

**POWER CENTER EQUIPMENT ROOM
PART PLAN EL. 257'-EXISTING CONDITIONS**

1" = 4'

